



—1" COLD WATER. REFER TO SHEET P1.01 FOR CONTINUATION. 3/4" COLD WATER TO HOSE BIBB. 3/4" COLD WATER. REFER TO 6/P4.02 FOR CONTINUATION TO EEW-1 & LAV-2.

2 trc sanitary riser SCALE | N.T.S.

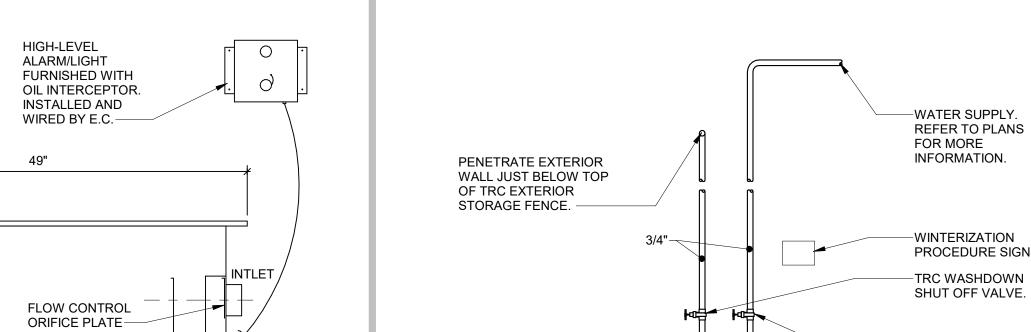

3 trc water supply riser SCALE | N.T.S.

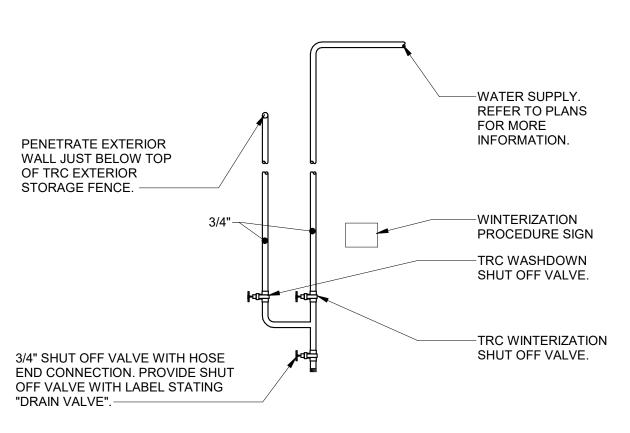

4 oil interceptor (int-2) SCALE | N.T.S.

—AIR RELIEF

SCREEN (ONE SIDED)—


115V POWER SUPPLY (SB-21)

ALARM-PROBE -SEDIMENT


BUCKET

TO LIGHT OR

ALARM

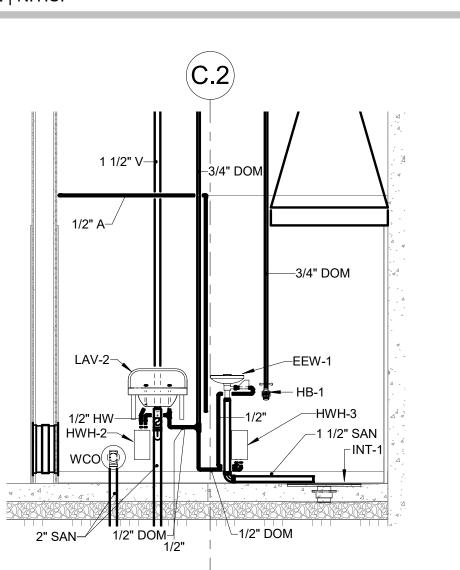

6 trc maintenance room hand sink elev scale | N.T.S.

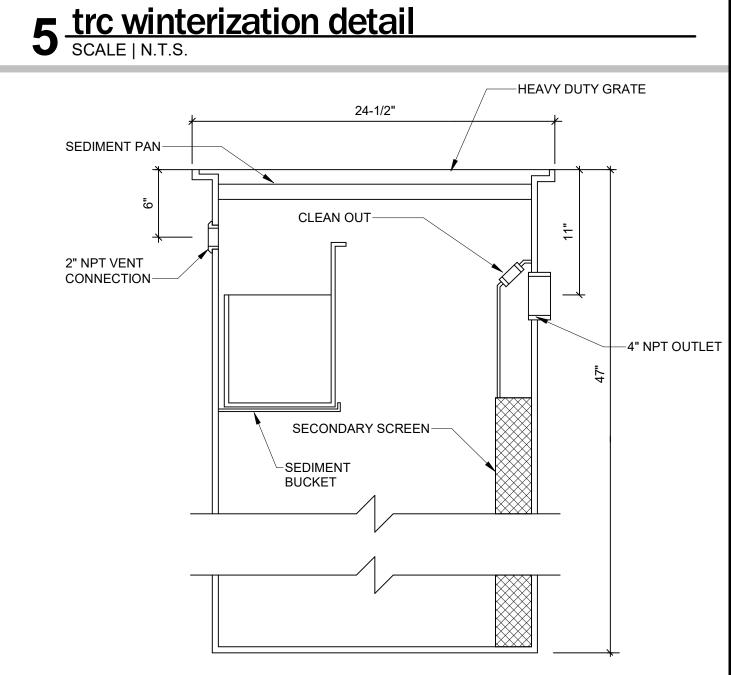

7 oil interceptor (int-1) SCALE | N.T.S.



1	WATTS #007M1QT DUAL CHECK BACKFLOW PREVENTER.
2	3/4" COLD WATER DOWN FOR POWER WASHER CONNECTION. PROVIDE SHUT-OFF VALVE AND CAPPED THREADED NIPPLE AT 60" A.F.F.
3	3/4" COLD WATER DOWN IN WASHING BOOTH TO HOSE BIBB AT 48" A.F.F. WITH VACUUM BREAKER.
4	3/4" COLD WATER DOWN TO SERVE LAV-2 AND EEW-1. REFER TO DETAIL P4.02-6 FOR ADDITIONAL

PROVIDE HEAVY DUTY AIR-HOSE WITH QUICK-CONNECT COUPLINGS FOR CONNECTION TO AIR COMPRESSOR MOUNTED ON WALL. REFER TO ARCHITECTURAL DRAWINGS FOR LOCATION AND MOUNTING DETAILS.

6 QUICK-CONNECT AIR HOSE COUPLING AT 39" A.F.F. 7 1/2" COPPER COMPRESSED AIR LINE TO DROP 24". PROVIDE 1/2" TO 1/4" REDUCER AND 1/4" VALVE FOR 8 1/2" COPPER COMPRESSED AIR LINE DOWN. PROVIDE QUICK-CONNECT AIR HOSE COUPLING AT 48" A.F.F. EXTEND 1/2" COMPRESSED AIR LINE DOWN TO 24" A.F.F. AND PROVIDE 1/2" TO 1/4" REDUCER AND 1/4" VALVE FOR BLOWDOWN. 9 CLEANOUT INTEGRAL WITH OIL INTERCEPTOR. SEE DETAIL P4.02-7 FOR MORE INFORMATION.

10 1-1/2" INDIRECT WASTE FROM EMERGENCY EYEWASH TO DISCHARGE INTO FLOOR DRAIN. SECURE PIPE TO WALL AT 6" A.F.F. 11 ROUTE VENT LINE FOR INTERCEPTOR OVER TO WALL AND UP. EXTEND TO VENT THRU ROOF.

12 3/4" COLD WATER DROP FOR HOSE BIBB (HB-1) MOUNTED AT 48" A.F.F. REFER TO DETAIL P5.01-03 FOR MORE INFORMATION.

13 3/4" COLD WATER AT FACE OF WASHING BOOTH TO HOSE BIBB AT 30" A.F.F. WITH VACUUM BREAKER. 14 1/2" COPPER COMPRESSED AIR LINE. 8'-0" A.F.F. AT 1/16" PER FOOT SLOPE. SLOPE TO BLOWDOWN LOCATION AS SHOWN.

PROVIDE 3/4" COLD WATER DOWN WALL TO 60" A.F.F. PROVIDE SHUT OFF VALVES SIMILAR TO DETAIL P4.02-5. PENETRATE EXTERIOR WALL AT 11'-6" A.F.F. AND ROUTE TIGHT TO WALL TO HOSE BIBB AS SHOWN ON PLAN. SLOPE PIPING FOR WINTERIZATION DRAINAGE. 16 EXTERIOR OIL INTERCEPTOR. SEE DETAIL P4.02-04 FOR MORE INFORMATION. CONTRACTOR TO VERIFY

LOCAL FROST DEPTH REQUIREMENTS AND PROVIDE CLEANOUT EXTENSIONS PRIOR TO INSTALLATION. 17 4" VENT FROM OIL INTERCEPTOR UP TIGHT TO WALL. TERMINATE AT 12'-0" A.F.G. WITH STUDOR VENT. 18 ROUTE VENT LINE FOR HAND SINK UP AND CONNECT TO VENT FROM INTERCEPTOR.

architect + engineer

WD PARTNERS 7007 DISCOVERY BLVD DUBLIN, OH 43017 614.634.7000 T

WDPARTNERS.COM

project no. | HDPB21180



THE HOME DEPOT 2455 PACES FERRY ROAD, C-19 ATLANTA, GA 30339-4024 PHONE: (770) 433-8211

project info DORAL, FL DORAL, FL STORE: 0000

prototype:

4C-2018 | XX/XX/18

issue dates 03/20/18 04/02/18 PERMIT 00/00/00 CONSTRUCTION revisions: /# description

checked by:

BID SET NOT FOR CONSTRUCTION

sheet info

PLAN AND DETAILS

TRC PLUMBING